

Design and Simulation of UPQC with Super-Capacitor to Energy Storage and Improve Power Quality

¹M. Siahi, ²M. Hoseynpoor, ²M. Najafi, ²R. Ebrahimi

¹Islamic Azad University, Garmsar Branch, Iran

²Islamic Azad University, Bushehr Branch, Iran

Abstract: This paper proposes a new configuration of UPQC (Unified Power Quality Conditioner) that consists of the DC/DC converter and the super-capacitors for compensating the voltage interruption. The proposed UPQC can compensate the reactive power, harmonic current, voltage sag and swell, voltage unbalance, and the voltage interruption. The performance of proposed system was analyzed through simulations with MATLAB\SIMULINK software. The proposed system can improve the power quality at the common connection point of the non-linear load and the sensitive load.

Key word: Unified power quality conditioner (UPQC), voltage interruption, DC/DC converter, super-capacitor

INTRODUCTION

Since several equipments such as computers, automation equipments, and communication equipments are very sensitive for the input voltage disturbances, the inadequate operation or the fault of these loads brings about huge losses (Hingorani, 1995), (Arrillaga *et al*, 2000), (Prodanovic and Green, 2003). The elimination or mitigation of disturbances propagated from the source side and the other loads interconnected is critical for improving the operational reliability of these critical loads.

One of the most interesting structures of energy conditioner is two back-to-back connected dc/ac fully controlled converters. In this case, depending on the control scheme, the converters may have different compensation functions. For example, they can function as active series and shunt filters to compensate simultaneously load current harmonics and supply voltage fluctuations. In this case, the equipment is called Unified Power Quality Conditioner (UPQC) (Akagi *et al.*, 2007), (Aredes and Watanabe, 1995), (Han *et al*, 2006).

Unified Power Quality Conditioner (UPQC) has been widely studied to eliminate or mitigate the disturbances propagated from the source side and the other loads interconnected (Hideaki and Hirofumi, 1998), (Aredes *et al*, 1998), (Han *et al*, 2006). UPQC has two voltage-source inverters of three-phase four-wire or three-phase three-wire configuration. One inverter called the series inverter is connected through transformers between the source and the common connection point. The other inverter called the shunt inverter connected in parallel with the load. The series inverter operates as a voltage source, while the shunt inverter operates as a current source.

UPQC can simultaneously mitigate the voltage disturbance in source side and the current disturbance in load side. UPQC can compensate voltage sag, voltage swell, harmonic current, and harmonic voltage, and control the power flow and the reactive power. However, it cannot compensate the voltage interruption because it has no energy storage in the DC link.

This paper proposes a new configuration of UPQC that consists of the DC/DC converter and the super-capacitors for compensating the voltage interruption. The operation of proposed system was verified through simulations with MATLAB\SIMULINK software.

MATERIALS AND METHODS

The proposed system is consisted of three main parts: configuration of proposed UPQC, DC/DC converter design and Energy storage design. Theses parts have discussed and finally the simulation results have been introduced.

1. Configuration of Proposed UPQC:

Figure 1 shows the configuration of proposed UPQC, which additionally has a DC/DC converter and super-capacitors for compensating the voltage interruption. The energy in the DC link charges the super-capacitors through the bi-directional DC/DC converter when the system is in normal operation.

The energy in the super-capacitors is released to the DC link through the bi-directional DC/DC converter when the voltage interruption occurs.

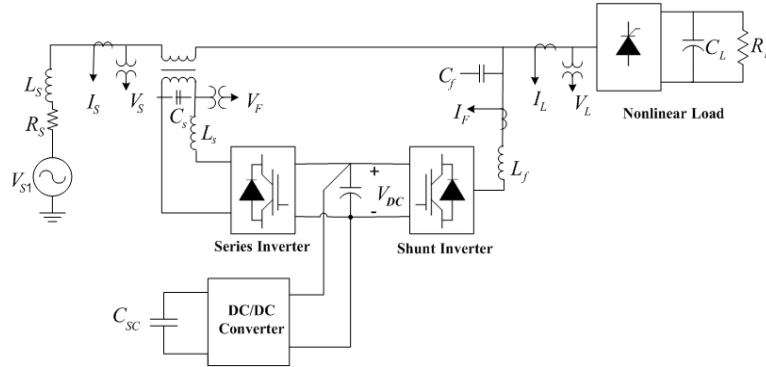


Fig. 1: Configuration of proposed UPQC with energy storage

The control system has three major elements which are shunt inverter control, series inverter control, and DC/DC converter control.

When the level of source voltage is maintained as 1.0 p.u., the system works in normal mode. When the level is between 0.5 and 1.0 p.u. or higher than 1.0 p.u., the system works in voltage sag or swell mode. When the level is lower than 0.5 p.u., the system works in interruption mode.

In normal mode, the series inverter injects the zero voltage and the shunt inverter absorbs the current harmonics generated by the load. The DC/DC converter works in charge mode or standby mode depending on the voltage level of the super-capacitors. In voltage sag or swell mode, the series inverter injects the compensating voltage to maintain the load voltage constant. The shunt inverter absorbs the current harmonics generated by the load and the DC/DC converter works in standby mode. In voltage interruption mode, the series inverter is disconnected from the line and the circuit breaker is opened to isolate the source side. The shunt inverter starts to work as an AC voltage source. The DC/DC converter works in discharge mode to supply the energy stored in the super-capacitors to the load.

The control strategy for the series and shunt inverters of the proposed UPQC has been derived based on the Synchronous reference frame method (Hu and Chen, 2000). The series inverter control compensates the voltage disturbance in the source side due to the fault in the distribution line.

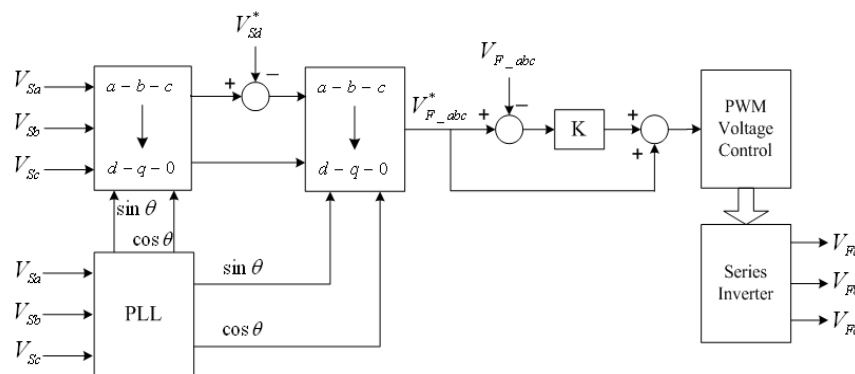


Fig. 2: Control block diagram of the shunt converter of the UPQC

The series inverter control determines the reference voltage to be injected by the series inverter as shown in fig. 2, using the algorithm described in reference (Hu and Chen, 2000). The shunt inverter control has two functions to compensate the current harmonics and the reactive power in normal operation, and to supply the active power to the load during the voltage interruption.

The first function was described in reference (Hu and Chen, 2000). The second function is same as that

of the power converter used in power system interconnection. The shunt inverter control has a selective switch as shown in fig. 3, which works in current control mode or voltage control mode under the control of system manager.

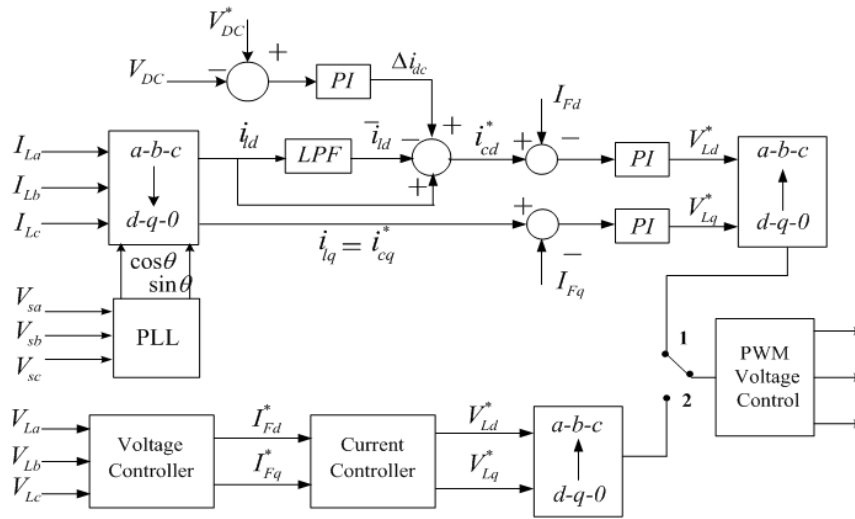


Fig. 3: Shunt inverter control block diagram

The DC/DC converter control works in charge mode or discharge mode selectively, depending on the direction from the system manager. In charge mode, the system manager monitors whether the voltage level of the super-capacitors exceeds the maximum operation voltage or not. If the voltage level reaches the maximum value, the DC/DC converter works in standby mode. In discharge mode, the system manager monitors whether the voltage level of the super-capacitors drops lower than the minimum operation voltage or not. If the voltage level reaches the minimum value, the DC/DC converter shuts down to stop supplying power to the load.

2. DC/DC Converter Design:

The DC/DC converter can operate in bi-directional mode using soft-switching Scheme (Bendre *et al*, 2003), (Jacobs *et al*, 2004). The operation voltage of the super-capacitor bank is in the range between 60-75V, while the dc link voltage is about 700V. The ground point in dc link should be isolated from the ground point in the super-capacitor bank. The converter should have high current rating in bank side and high voltage rating in DC link side. Considering these requirements, a DC/DC converter with two full-bridges was selected as shown in Figure 4.

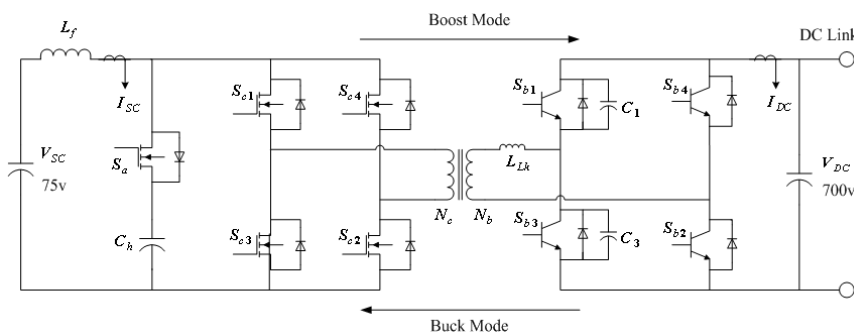


Fig. 4: DC/DC converter structure

A filter reactor is inserted between the bank and the full-bridge to reduce the ripple of charging and discharging current, which can reduce the lifetime of super-capacitors due to unwanted heat generation. The full-bridge in bank side works as a current-fed type, while the full-bridge in DC link side works as voltage-fed type.

The DC/DC converter boosts the super-capacitor voltage up to the nominal DC link voltage in discharge mode. The super-capacitor voltage is controlled between 60-75V, while the DC link voltage increases up to 700V. The switches S_{C1} and S_{C2} operate with a duty ratio of higher than 0.5. The current through the inductor L_f increases as all the switches are on conduction-state. The voltage overshoot can be suppressed by turning on auxiliary switch S_a when two switches in face with diagonal opposition are on conduction state. The current through transformer rises linearly and its peak value becomes larger than the current through the boost inductor. When the auxiliary switch turns off, the magnetic energy stored in the leakage inductance of transformer flows through the back-connection diode of the switch in off state. So, the zero-voltage turn-on condition is provided.

The DC/DC converter decreases the nominal DC-link voltage down to the level of super-capacitor voltage in charge mode. When switch S_{b1} and S_{b2} turns on, the input voltage applied to the leakage inductance of transformer L_{Lk} increases the input current. The power in the primary side is transferred to the secondary side. The secondary voltage charges the capacitor C_h through the reverse-connected diode of auxiliary switch S_a . If the charging voltage is high enough to make the charging current zero, switch S_{b1} turns off. Switch S_{b3} turns on with zero-voltage scheme while the capacitor C_l is charged and the capacitor C_3 is discharged. When auxiliary S_a turns on, the voltage across the auxiliary capacitor affects the primary voltage of the coupling transformer. This voltage is applied to the leakage inductance L_{Lk} with reverse polarity. This makes the primary current zero and switch S_{b2} turns off with zero-current scheme.

3. Energy Storage Design:

The size of super-capacitors is determined depending on the duration of voltage interruption and the size of load connected. It is assumed that the maximum voltage interruption has duration of three seconds and the load has a power rating of 10kW. Therefore, total energy to be released during the voltage interruption is 30 kJ.

The bank of super-capacitors is designed considering three criteria, the expandability of storage capacity, the unbalance of unit voltage, and the current rating of each unit. HP1700P-0027A manufactured by Ness Company was selected as a basic unit for the energy storage bank. Table 1 shows the specification of selected super-capacitor unit.

Table 1: Specification of super-capacitor unit

Capacitance	1700 F
Continuous operation voltage	2.7V
Peak operation voltage	2.85V
Current rating	360A

The bank is designed so as to utilize the upper 25% of maximum storage capacity, considering the expandability of operation capacity by adding more super-capacitors. The maximum current flows through the super-capacitor bank, when it discharges the maximum power. The minimum voltage across the super-capacitor bank can be determined with the maximum discharge power and the current rating as the following.

$$U_{bank_min} = 20kW / 360A = 55.5V \quad (1)$$

It is assumed that the super-capacitor is charged by 2.43V, which is 90% to the maximum charging voltage of 2.7V, for consideration of 10% margin. The lowest discharged voltage is determined to be 2.1V using the following.

$$U_{unit_min} = \sqrt{3/4} \times U_{unit_max} = 2.1V \quad (2)$$

Therefore, the lowest discharge voltage and the minimum unit voltage determine the number of units to be connected in series as the following.

$$N = U_{bank_min} / U_{unit_min} = 55.5 / 2.1 = 26.5 \quad (3)$$

However, the bank can be designed using total 28 units of super-capacitors for the purpose of safety margin.



Table 2: Grid parameters

Source Phase Voltage (<i>rms</i>)	220v / 50Hz
DC Link voltage	600v
Shunt inverter rating	45kVA
Series inverter rating	15kVA
Shunt inverter Inductance (L_p)	3mH
Shunt inverter Capacitance (C_p)	10 μ F
Switching Frequency	20kHz
Series inverter Inductance (L_s)	3mH
Series inverter Capacitance (C_s)	15 μ F
Series inverter Resistance (R_s)	12 Ω
PV Array Rating	40kW

RESULTS AND DISCUSSION

The power circuit is modeled as a 3-phase 3-wire system with a non-linear load that is composed of 3-phase diode-bridge with RC load in the DC side with a THD of more than 40%. The circuit parameters used in the simulation is shown in Table 2. The maximum simulation time was set up by 1.5sec. It is assumed that the shunt inverter start to operate at 100 msec, while the series inverter start to operate at 200 msec.

The load current is shown in fig. 5. In fig. 6 the active and reactive power consumed by the load are demonstrated.

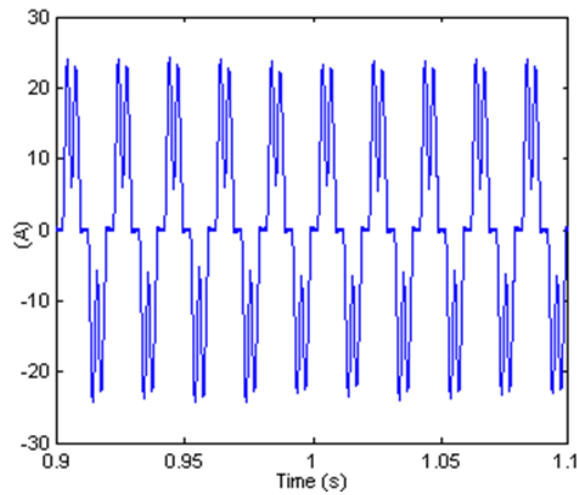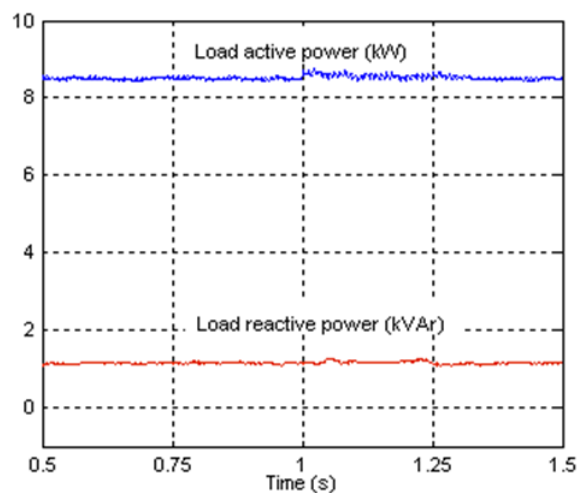**Fig. 5:** Nonlinear load current**Fig. 6:** Active and reactive power consumed by load

In this section, voltage sag is applied and the results are studied. A voltage sag with peak amplitude of 100v is applied from $t=1\text{sec}$ to $t=1.3\text{sec}$. The source and load voltage are shown in fig. 7. It is seen in this figure that the UPQC series inverter has modified load voltage correctly.


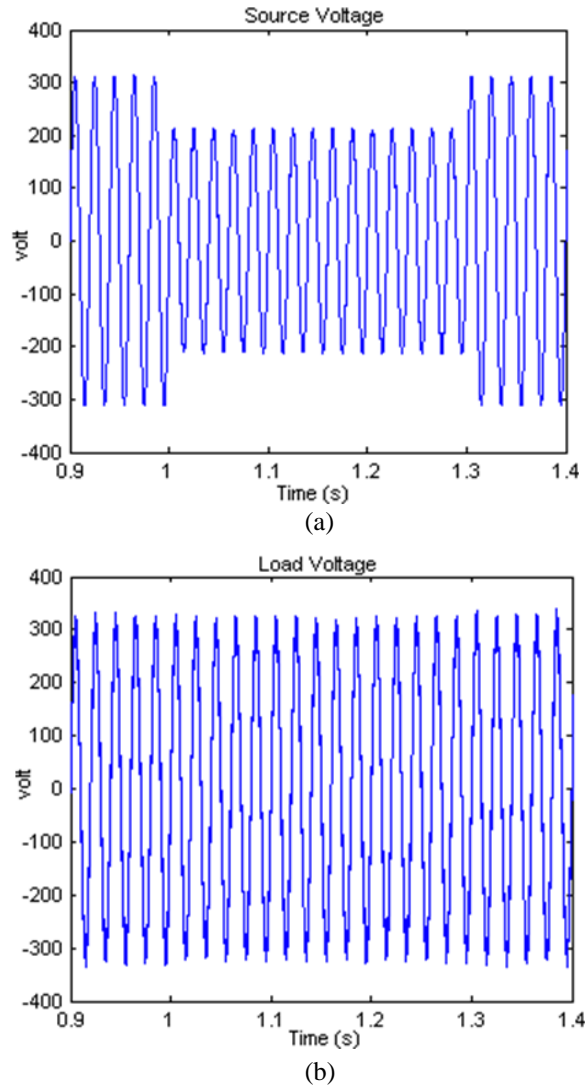


Fig. 7: Voltage sag compensation. (a) Source voltage. (b) Load voltage


In this section, voltage interruption occurs from $t=1\text{sec}$ to $t=1.3\text{sec}$. Fig. 8 shows the source and load voltage and the output current supplied by the DC/DC converter respectively. It is seen that after voltage interruption, load voltage is remained at its desired value due to shunt inverter operation.

Conclusion:


This paper proposes a new configuration of UPQC that consists of the DC/DC converter and the super-capacitors for compensating the voltage interruption. The proposed UPQC can compensate the reactive power, harmonic current, voltage sag and swell, voltage unbalance, and the voltage interruption. The control strategy for the proposed UPQC was derived based on the Synchronous reference frame method. The operation of proposed system was verified through simulations with MATLAB/SIMULINK software. The proposed UPQC has the ultimate capability of improving the power quality at the installation point in the distribution system. The proposed system can replace the UPS, which is effective for the long duration of voltage interruption, because the long duration of voltage interruption is very rare in the present power system.

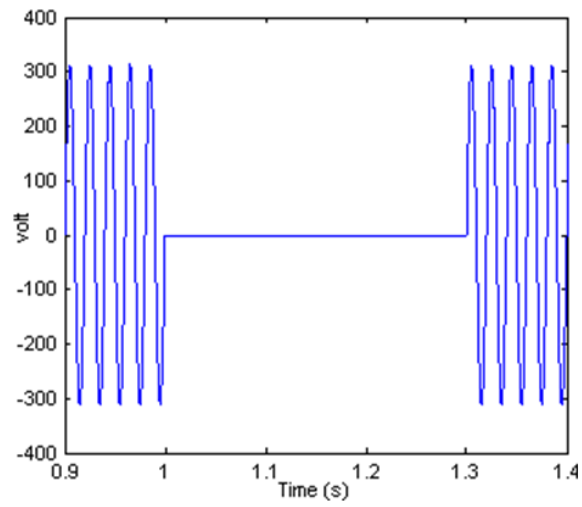

(a)

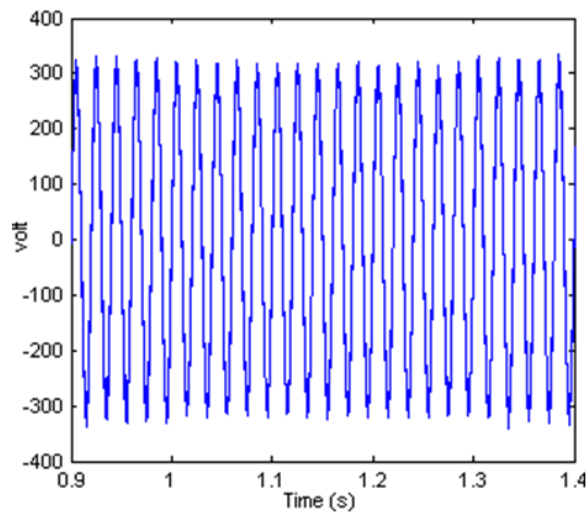

(b)

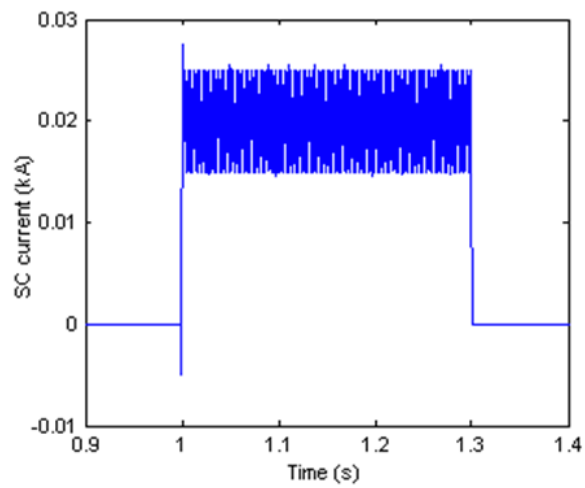

(c)

Fig. 8: Voltage interruption compensation. (a) Source Voltage. (b) Load voltage

REFERENCES

- Akagi H., Y. Kanazawa and A. Nabae, 2007. Instantaneous reactive power compensator comprising switching devices without energy storage components. *IEEE Transactions on Industry Application*, 20: 625-630.
- Aredes, M., K. Heumann, E.H. Watanabe, 1998. An universal active power line conditioner. *IEEE Transactions on Power Delivery*, 13(2): 545-551.
- Aredes, M. and E.H. Watanabe, 1995. New control algorithms for series and shunt three-phase four-wire active power Filters. *IEEE Transactions on Power Delivery*, 10: 1649-1656.
- Arrillaga, J., M.H.J. Bollen, N.R. Watson, 2000. Power quality following deregulation. *Proceedings of the IEEE*, 88(2): 246-261.
- Bendre, A., S. Norris, D. Divan, I. Wallace, 2003. New high power DC/DC converter with loss limited switching and lossless secondary clamp. *IEEE Transactions on Power Electronics*, 18(4): 1020-1027.
- Han B., B. Bae, H. Kim, S. Baek, 2006. Combined Operation of Unified Power Quality Conditioner With Distributed Generation. *IEEE Transactions on Power Delivery*, 21: 330-338.
- Han, B., B. Bae, S. Baek, G. Jang, 2006. New configuration of UPQC (unified power quality conditioner) for medium-voltage application. *IEEE Transactions on Power Delivery*, 21(3): 1438-1444.
- Hideaki, F. and A. Hirofumi, 1998. The unified power quality conditioner: the integration of series- and shunt- active filters. *IEEE Transactions on Power Electronics*, 13(2): 315-322.
- Hingorani, N.G., 1995. Introducing custom power. *IEEE Spectrum*, 32(6): 41-48.
- Hu, M. and H. Chen, 2000. Modeling and Controlling of Unified Power Quality Compensator. *IEEE International Conference on Advances in Power System Control, Operation and Management*, 2: 431-435.
- Jacobs, J., A. Averberg, R. De Doncker. 2004. A novel three-phase DC/DC converter for high-power applications. *IEEE Power Electronics Specialists Conference*, 3: 1861-1867.
- Prodanovic, M. and T.C. Green, 2003. Control and filter design of three-phase inverters for high power quality grid connection. *IEEE Transactions on Power Delivery*, 18(1): 373-380.